



**INSTITUT IMS AD
BEOGRAD**

**IMS Institute ad, Belgrade
Central Laboratory for Materials Testing
Laboratory for Acoustics and Vibrations**

Belgrade, Vojvode Misica Blvd 43
tel: (0038111) 2650 322 fax: (0038111) 3692 772, 3692 782
www.institutims.rs

TEST REPORT

No. LAV 7625/23

Subject:	INSERTION LOSS AND TRANSMISSION LOSS OF DUCTED SILENCER – GREENDEC50 Sanitized (glass wool blanket 50 mm)
Client:	DEC INTERNATIONAL, Panonska 14, Stara Pazova, Republic of Serbia
Requirement / Offer / Contract:	IMS No. 41-7829 from 26th June 2023. / 41-7840 from 26th June 2023.
Contents:	Number of pages in report is 8 and in annex 2 pages
Report approval:	Laboratory for Acoustics and Vibrations Manager, Aleksandar Milenković, M.Sc.

Belgrade, September 20th 2023.

TASK

The measurement of insertion loss and transmission loss of ducted silencer **GREENDEC50 Sanitized (glass wool blanket 50 mm)**, with a length of 500 mm, 750 mm, 1000 mm, 1500 mm and seven diameters 82 mm, 102 mm, 127 mm, 160 mm, 203 mm, 254 mm and 315 mm in accordance with Standard ISO 7235.

TEST METHOD AND INSTRUMENTATION COMPLIANCE

Test method is given in following Standard:

ISO 7235:2003, Acoustics – Laboratory measurement procedures for ducted silencers and air-terminal units – Insertion loss, flow noise and total pressure loss (idt. EN ISO 7235:2009, SRPS EN ISO 7235:2010).

Measurement equipment satisfies following Standards:

EN 1260-1:2014, Electroacoustics – Octave-band and fractional-octave-band filters – Part 1: Specifications and

EN 61672-1:2013, Electroacoustics – Sound level meters – Part 1: Specifications.

DATE AND LOCATION OF TEST

Tests were performed on 29th August and 1st September 2023. in reverberation room (room volume: $V = 241.3 \text{ m}^3$) of Laboratory for acoustics and vibrations of IMS Institute, Viktora Igoa Str 7 in Belgrade.

MEASURING EQUIPMENT AND INSTRUMENTATION

Transmitting equipment:

White noise generator, model MINIRATOR MR-PRO (No G2P-XCJAS-F1), manufactured by NTI, power amplifier, model Plena (No ZX000639003513), manufactured by Bosch and pressure chamber with loudspeaker Evertone model CS-SW1250.

Receiving equipment:

Sound Level Meter, 1/1 and 1/3 octave band analyzer, model NA-28 (No 01260208), manufactured by Rion, Japan, with microphone UC-59 (No 00291); calibration certificate No. 323-2/3-02-208/2 from 9.3.2021.

Weather station, model TFA, SINUS Germany, No 35-1095.


MEASUREMENT CONFIGURATIONS

Insertion loss measurement (sound power level reduction along silenser)

The measurement configuration in accordance with test method for the determination of insertion loss is shown on Figure 1.

Sound pressure levels in reverberation room were measured in 6 discrete microphone positions with the silencer (test specimen) and in same 6 discrete microphone positions with the silencer replaced by a compensation channel.

Photografies of the measurement configuration are given on Figure 2.

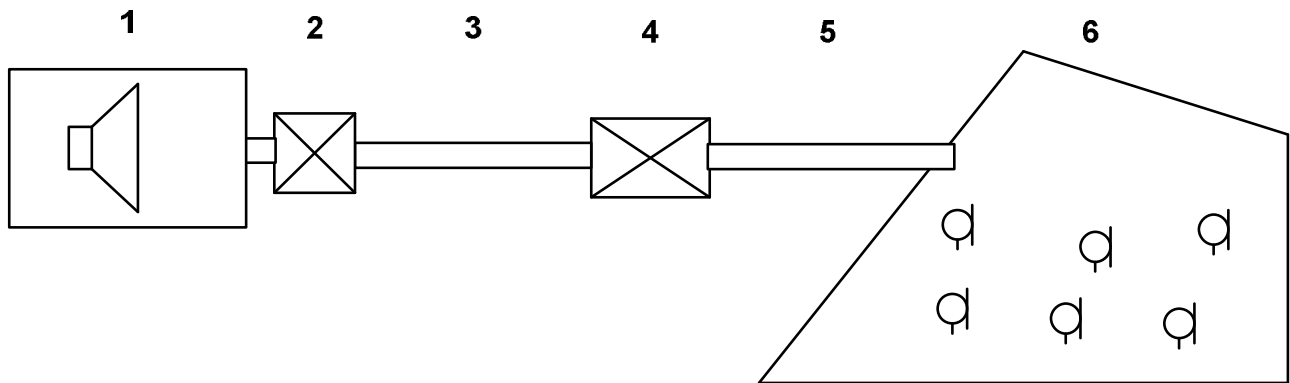

F

Figure 1. Measurement configuration in accordance with ISO 7235 for insertion loss measurement;

- 1) Pressure chamber with loudspeaker,
- 2) Modal filter (silencer with circular connection Ø 400 mm with a length of 600 mm);
- 3) Circular duct 82 mm, 102 mm, 127 mm, 160 mm, 203 mm, 254 mm and 315 mm,
- 4) Silencer (specimen of test object),
- 5) Circular duct 82 mm, 102 mm, 127 mm, 160 mm, 203 mm, 254 mm and 315 mm,
- 6) Reverberation room with volume 241.3 m³.

Transmission loss measurement (sound power level reduction through the wall of silencer)

The measurement configuration in accordance with test method for the determination of transmission loss is shown on Figure 2.

Sound pressure levels in reverberation room were measured in 6 discrete microphone positions with the silencer (test specimen) and in same 6 discrete microphone positions without the silencer.

Photografies of the measurement configuration are given on Figure 4.

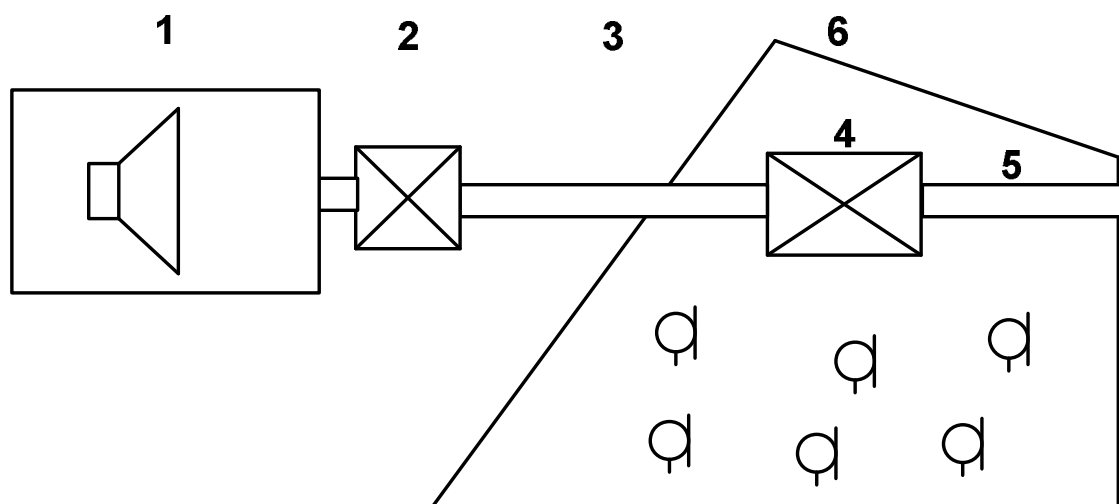


Figure 2. Measurement configuration in accordance with ISO 7235 for transmission loss measurement;

- 1) Pressure chamber with loudspeaker,
- 2) Modal filter (silencer with circular connection \varnothing 400 mm with a length of 600 mm);
- 3) Circular duct 82 mm, 102 mm, 127 mm, 160 mm, 203 mm, 254 mm and 315 mm,
- 4) Silencer (specimen of test object),
- 5) Circular duct 82 mm, 102 mm, 127 mm, 160 mm, 203 mm, 254 mm and 315 mm,
- 6) Reverberation room with volume 241.3 m³.

TEST FACILITY

Draft of testing room is given in Figure 3. Diffusers in the room are acoustic reflectors made by plywood of thickness $d = 6$ mm. Total number of acoustic reflectors is 23.

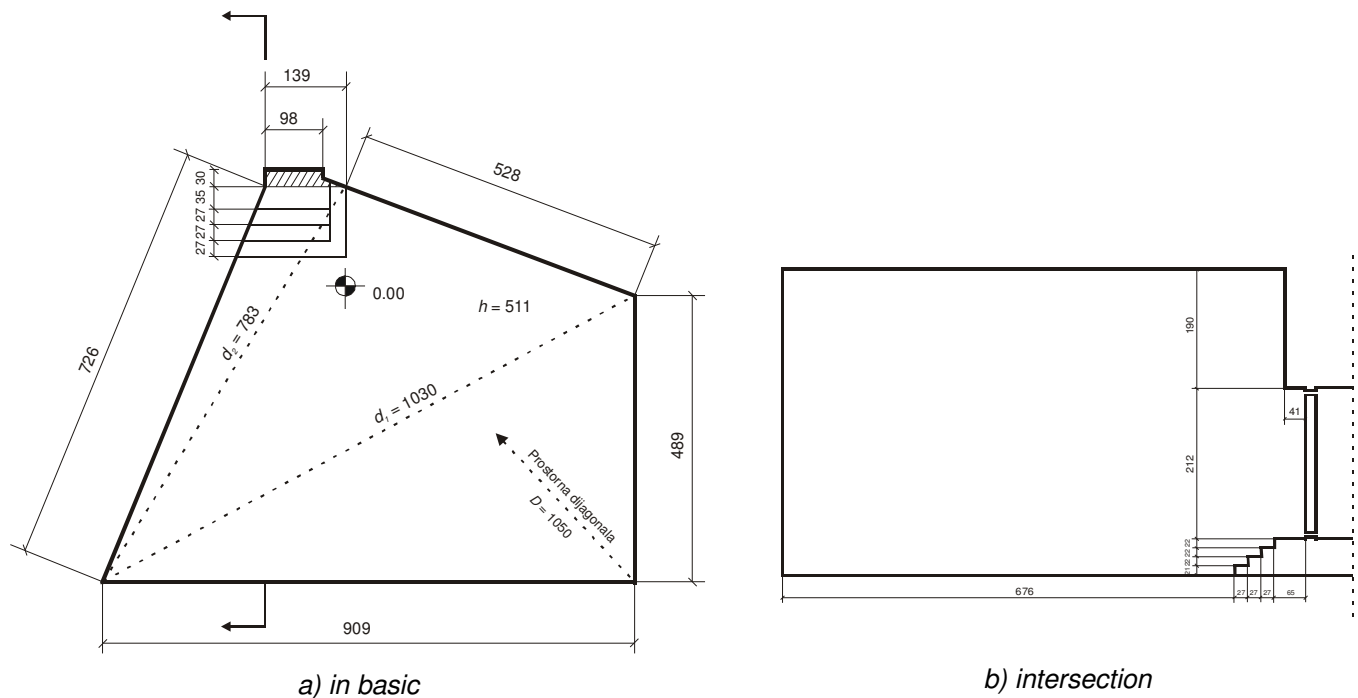


Figure 3. Reverberation room

TESTING RESULTS

Sound pressure levels at each microphone position were measured with an integration time of 10 s in 1/1 octave bands in the frequency range from 63 Hz to 8000 Hz.

Each result of insertion loss D_i is the difference of a logarithmic average of measured sound pressure levels at all measurement positions with test specimen and with compensation channel at given frequency band.

Testing results of insertion loss D_i in dB are given on page 6.

Each result of transmission loss D_t is the difference of a logarithmic average of measured sound pressure levels at all measurement positions with and without test specimen at given frequency band increased with transmission loss of open end of test specimen D_{td} .

Testing results of transmission loss D_t in dB are given on page 7.

Estimated standard deviation of reproducibility for each frequency bands are given in ISO 7235:2003, Table 7. Measurement uncertainty U must be expressed as an expanded measurement uncertainty obtained by multiplying estimated standard deviation of reproducibility by the coverage factor $k = 2$, which corresponds to a confidence level of 95%.



CLIENT: DEC INTERNATIONAL, Panonska 14, 22300 STARA PAZOVA, Republic of Serbia

TEST SUBJECT (SPECIMEN):
GREENDEC50 Sanitized (glass wool blanket 50 mm)
consists of a **Polypropylene fabric cloth inner duct**, protected with the antimicrobial Sanitized
hygienic function.

DATE OF TEST: 29th August and 1st September 2023.

ENVIRONMENTAL CONDITIONS:

29th August 2023.: $t = 25^{\circ}\text{C}$, $\psi = 60\%$, 1st September 2023: $t = 25^{\circ}\text{C}$, $\psi = 61\%$

Test method according to ISO 7235:2003

GREENDEC50 Sanitized (glass wool blanket 50 mm)									
\varnothing (mm)	L (mm)	Insertion loss D_i (dB)							
		63 Hz	125 Hz	250 Hz	500 Hz	1000 Hz	2000 Hz	4000 Hz	8000 Hz
82	500	10.3	6.7	12.9	23.3	32.5	41.4	39.1	20.8
102	500	1.8	10.6	18.9	24.4	27.3	35.4	36.5	15.0
127	500	2.2	7.9	14.2	21.5	25.1	32.7	27.6	12.3
82	750	5.4	10.8	19.9	38.4	41.1	48.2	39.7	21.4
102	750	4.1	12.3	22.3	30.3	37.1	45.7	42.2	20.8
127	750	13.3	17.1	28.4	28.9	30.5	42.3	38.6	17.0
82	1000	7.3	15.7	30.0	38.9	39.8	45.7	39.4	21.4
102	1000	4.9	15.8	26.5	35.9	38.9	47.8	42.9	23.2
127	1000	9.5	14.8	22.8	35.9	39.1	48.2	42.1	21.5
82	1500	11.8	24.0	38.8	43.6	39.7	47.6	39.7	21.5
102	1500	8.1	18.9	40.4	46.4	40.7	50.1	43.0	24.1
127	1500	13.7	18.7	35.4	47.5	43.2	49.5	43.4	26.1
160	500	0.1	8.4	19.0	17.0	19.6	24.4	16.7	13.4
203	500	4.0	9.3	15.0	13.4	15.9	18.2	11.5	3.0
254	500	4.5	8.4	11.5	11.4	14.1	11.7	4.4	3.0
315	500	1.8	7.0	8.7	9.8	11.5	6.4	3.7	3.4
160	750	0.4	9.8	21.8	22.4	25.3	32.6	22.4	15.1
203	750	3.5	14.7	20.8	20.0	22.3	25.9	16.0	6.9
254	750	3.6	12.0	14.8	16.9	21.5	17.9	8.4	6.6
315	750	1.5	7.6	10.9	14.0	17.9	10.6	4.2	1.5
160	1000	1.5	16.6	24.8	29.1	32.1	42.5	31.9	19.4
203	1000	4.1	12.8	18.5	27.3	30.0	34.0	22.7	11.3
254	1000	5.8	13.6	19.6	21.5	28.6	22.2	10.8	7.8
315	1000	2.5	9.1	16.1	20.3	22.9	15.5	7.7	5.0
160	1500	3.8	16.4	32.0	41.4	38.7	45.3	40.7	22.5
203	1500	7.0	17.9	34.0	34.4	34.7	41.2	31.5	13.6
254	1500	8.2	19.4	28.8	29.6	34.6	28.9	16.1	13.6
315	1500	2.1	11.4	23.1	26.9	30.9	19.3	9.4	11.0

GREENDEC50 Sanitized (glass wool blanket 50 mm)									
Ø (mm)	L (mm)	Transmission loss D_t (dB)							
		63 Hz	125 Hz	250 Hz	500 Hz	1000 Hz	2000 Hz	4000 Hz	8000 Hz
82	500	39.4	33.7	29.3	22.7	19.4	18.6	21.3	18.3
102	500	29.4	25.2	16.9	13.6	11.4	13.5	16.0	16.3
127	500	32.4	24.3	20.8	14.8	14.4	14.9	17.5	18.0
82	750	38.1	31.4	26.9	19.7	17.3	16.0	18.8	17.7
102	750	31.1	25.3	18.6	14.1	11.4	13.6	15.9	15.9
127	750	28.1	23.7	17.6	10.5	11.2	12.6	15.5	17.7
82	1000	33.2	26.9	20.5	14.7	11.3	11.5	15.2	17.0
102	1000	31.4	25.9	17.0	12.2	8.9	12.3	15.0	17.0
127	1000	31.3	24.4	18.9	11.3	10.8	12.8	16.3	18.2
82	1500	37.5	27.6	20.4	11.8	10.0	10.5	14.2	17.0
102	1500	27.9	24.4	18.2	13.7	9.9	12.8	15.7	17.0
127	1500	32.7	25.1	19.1	11.3	12.1	14.1	16.4	18.1
160	500	22.8	20.7	16.7	11.6	12.1	13.5	16.3	15.3
203	500	30.9	21.1	13.6	9.0	10.3	14.0	17.3	8.9
254	500	29.9	20.6	11.5	10.0	11.4	13.7	18.1	12.4
315	500	28.0	18.5	12.4	11.0	10.9	12.4	16.5	17.2
160	750	23.0	22.2	17.6	11.3	11.9	12.8	15.1	15.4
203	750	27.1	22.4	13.3	8.3	10.0	13.4	16.6	8.6
254	750	29.5	21.0	13.0	11.9	12.6	14.2	17.8	12.3
315	750	29.0	19.8	14.0	12.2	11.8	12.3	16.9	17.8
160	1000	22.8	23.0	18.2	12.7	13.1	13.9	15.8	15.8
203	1000	29.8	22.5	14.1	8.9	10.3	14.1	16.5	9.3
254	1000	29.4	23.1	14.3	14.1	14.2	15.1	17.3	13.1
315	1000	25.3	19.9	13.0	11.0	11.0	11.8	15.7	17.6
160	1500	24.4	21.2	16.9	10.8	11.8	13.2	15.7	16.1
203	1500	27.1	22.2	13.5	8.7	9.9	13.6	16.1	9.2
254	1500	29.4	23.4	16.3	15.8	15.4	16.3	18.8	14.9
315	1500	24.6	21.1	14.6	13.1	13.0	13.1	16.6	18.4

EXECUTANT OF TESTING: Stevka Baralić, eng.



IMS Institute ad, Belgrade
Central Laboratory for Materials Testing
Laboratory for Acoustics and Vibrations

Belgrade, Vojvode Misica Blvd 43
tel: (0038111) 2650 322 fax: (0038111) 3692 772, 3692 782
www.institutims.rs

CONCLUSION

It was performed the measurement of insertion loss and transmission loss of ducted silencer **GREENDEC50 Sanitized (glass wool blanket 50 mm)**, with a length of 500 mm, 750 mm, 1000 mm, 1500 mm and seven diameters 82 mm, 102 mm, 127 mm, 160 mm, 203 mm, 254 mm and 315 mm and in accordance with Standard ISO 7235 in accordance with Standard ISO 7235.

Technical description of test object made by Client is given in the annex of the Test Report.

Testing results of insertion loss D_i are given on page 6 and of transmission loss D_t are given on page 7 in all 1/1 octave bands in the range from 63 Hz to 8000 Hz.

Test manager

Aleksandar Milenković, M.Sc.

ANNEX

- Product Technical Specification of test object made by Client (2 pages)

- The End of Test Report -